

CONTROL OF START-UP OF AN OSA SYSTEM: AN APPROACH TO REDUCE EXCESS SLUDGE PRODUCTION

S. Rodríguez Pérez¹, J.C. Gutiérrez², C. Arnáiz¹

¹Departamento de Ingeniería Química y Ambiental, Escuela Politécnica Superior, Universidad de Sevilla, SPAIN. e-mail: santingor@us.es, carnaiz@us.es. ²Departamento de Biología Molecular e Ingeniería Bioquímica, Facultad de Ciencias Experimentales, Universidad Pablo de Olavide, Sevilla, SPAIN. e-mail: jcgutmar@upo.es

INTRODUCTION

In most biological wastewater treatment process such as conventional activated sludge (CAS) system, though they have been recognized to be effective for organic wastewater treatment, the large amount of excess sludge derived from microbial growth generates high costs in equipment, operation, and final disposal. The OSA process is a modification of CAS process which can reduce sludge production by inserting a holding tank in return sludge circuit. In this holding tank, oxygen is not supplied so that excess sludge production can be reduced by an alternating exposure of activated sludge to oxic and anoxic environments (Saby *et al.*, 2003; Chen *et al.*, 2003; Jung *et al.*, 2006; Rodríguez-Pérez *et al.*, 2009; Rodríguez-Pérez *et al.*, 2010). However, a better understanding of the cause of the process enabling excess sludge reduction is necessary for full scale experience. In this study, our experiments were carried out in two CAS systems, one of them modified to an OSA system. Primary experiments were carried out and the control of DO, pH and temperature were investigated after the seed sludge inoculation.

METHODS

The pilot plants are illustrated in Fig. 1. The reactors had a working volume of 2.5 L and a 2.7 L settler. One of them was modified as an OSA system by inserting a 1.3 L sludge holding tank in the sludge return circuit. The air was supplied through the reactor liquid phase using an air sparger at the bottom. DO concentration and pH value in the reactors and holding tank were measured by a DO (HQ30D Flexi, Hach-Lange) and pH (GLP22, Crison) meter, respectively. The oxygen concentration was varied during the start-up until which was adjusted around 5 mg L⁻¹. The pH was maintained around 7 by phosphate buffer solution. Full mixing within the reactors and holding tank were achieved with magnetically stirrers. The feeding solution of synthetic wastewater was added to the reactors using peristaltic pumps.

The reactors and holding tank were inoculated with 1 L and 0.5 L, respectively. The sludge was taken from the recirculation line of the aeration tank of the West Urban Wastewater Treatment Plant of Sevilla, (Spain). The seed mixture contained initial biomass concentrations of 6 g_{MLSS} L⁻¹ and 5 g_{MVSS} L⁻¹. Initial mixed liquor suspended solids (MLSS) concentration in aerobic reactors was adjusted to about 2.5g_{MLSS} L⁻¹, with 1.5 g_{MVSS} L⁻¹. The influent COD concentration was to 330 mg L⁻¹. The synthetic wastewater used in this experiment was a mineral medium, with glucose as carbon source. The hydraulic retention time (HRT) was controlled at 12 h in the aerobic reactors and at 3.5 h in the anoxic holding tank. The operation was all conducted at a room temperature (25°C). COD, TSS and VSS were measured according to Standard Methods (APHA-AWA-WPCF,1992).


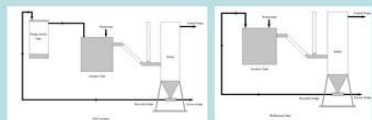


Figure 1. Schematic diagram of two experimental systems (the reference and OSA system).

RESULTS AND DISCUSSION

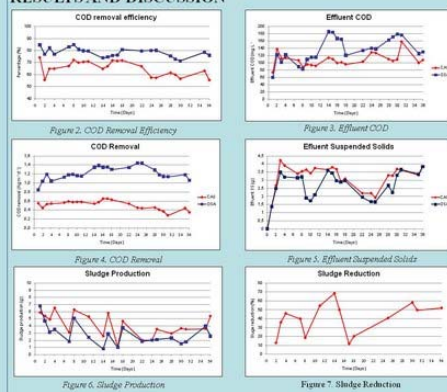

During the start-up period, removal efficiencies of COD were above 64% and 73% under control CAS and OSA system, respectively as shown in Fig. 2. The average effluent COD is shown in Fig. 3. It was found a variable initial period by start-up in both pilot plants. The first week was observed the same levels between both plants. CAS Control and OSA process. After this period the levels COD effluent was increased in OSA process. It was found that concentrations under control and OSA system were 84 mg L⁻¹ and 154 mg L⁻¹, respectively. The higher value for COD in OSA system could be attributed to the cell debris introduced from the anoxic tank into the aerobic reactor. Fig. 4 shows the COD removal expressed as kg m⁻³ d⁻¹, under OSA process conditions the level of COD removal was higher than under control conditions. The effluent SS from the settling tanks of the two pilot plants was also examined during the start-up and found no obvious increase in the effluent SS from the settling tank of OSA system, as shown in Fig. 5. Sludge production is summarized in Fig. 6. It is observed that both systems have similar levels of production, although control system production was above the OSA system production. Fig. 7 indicates the sludge reduction ratios. It was found that in the OSA system ranged between 60% under the experimental conditions, if it was compared with the reference system. Fig. 8 shows the relationship between the sludge production and COD removed. It was determined that under control conditions is higher, because of a higher sludge production and lower COD removed.

CONCLUSIONS

From this study it is concluded that OSA system shows a good potential for domestic wastewater treatment. It was tested with synthetic wastewater and presented promising performance after 36 days of operation: 60 % of carbon removal with a loading rate of 0.8 kg_{COD} m⁻³ day⁻¹. On the other hand, excess sludge production was reduced around 60% during the start-up period. Since in this work it is described the start-up of this process, it is expected better results in COD removal, sludge reduction and a process more stable. Finally, it was observed that the relationship between the sludge production and COD removed, under OSA system conditions had lower oscillation on results, this suggests that the OSA process could be maintained over time.

REFERENCES

- APHA-AWA-WPCF, 1992. Standard Methods for the Examination of Water and Wastewater. In: Clesceri, L.S., Greenberg, A., Trussell, R. (Eds.), American Public Health Association, 18th ed. Washington, DC, USA, pp. 2-71.
- Chen, G.H., An, K.J., Saby, S., Brou, E. and Djafer, M. (2003). Possible cause of excess sludge reduction in an oxic-settling-anoxic activated sludge process (OSA process). Wat. Res., 37(16), 3855-3866.
- Sebastien Sabya, Malik Djafer, Guang-Hao Chenb. (2003). Effect of low ORP in anoxic sludge zone on excess sludge production in oxic-settling-anoxic activated sludge process. Wat. Res., 37, 3855-3866.
- Rodríguez-Pérez, S., Arnáiz, C., Gutiérrez, J.C. and Díaz, E. (2009). Reducción de la producción de fangos de exceso en EDAR a FAC, mediante la implantación de un sistema OSA. VI Jornadas de Transferencia de Tecnología sobre Microbiología del Fango Activo. Sevilla, Spain. ISBN 978-84-613-7691-9.
- Rodríguez-Pérez, S., Arnáiz, C., Gutiérrez, J.C. and Díaz, E. (2010). Reduction of excess sludge production in activated sludge process by intermittent aeration. 7th ANQUE International Congress. Oviedo, Spain. ISBN 978-84-693-2258-1.
- Sang-Tian Yan, Hao Zheng, An Li, Xue Zhang, Xin-Hui Xing, Li-Bing Chou, Xu-Lin Sun, Benjamin Jurcik. (2009). Systematic analysis of biochemical performance and the microbial community of an activated sludge process using ozone-treated sludge for sludge reduction. Bioresource Technology, 100, 5002-5009.